

P-0013.19

**METROPOLITAN UTILITIES DISTRICT**

**1723 HARNEY STREET  
OMAHA, NEBRASKA 68102-1960**

**DANIEL G. CROUCHLEY  
SENIOR VICE PRESIDENT  
GENERAL COUNSEL  
402-504-7130  
F-402-504-5130  
DAN\_CROUCHLEY@MUDNEBR.COM**

**A. JUSTIN COOPER  
ATTORNEY  
402-504-7218  
F-402-504-5218  
JUSTIN\_COOPER@MUDNEBR.COM**

**SUSAN E. PRAZAN  
ATTORNEY  
402-504-7227  
F-402-504-5227  
SUSAN\_PRAZAN@MUDNEBR.COM**

**PATRICK L. TRIPP  
ATTORNEY  
402-504-7192  
F-402-504-5192  
PATRICK\_TRIPP@MUDNEBR.COM**


November 24, 2008

**To:** Nebraska Public Service Commission  
**From:** Daniel G. Crouchley, Senior Vice President, General Counsel  
**Subject:** Notice of Proposed Extension of Gas Service

The Metropolitan Utilities District of Omaha (M.U.D.) hereby provides the Nebraska Public Service Commission with the notice required by Neb. Rev. Stat. Section 66-1863 that it intends to extend its gas service as follows:

**GSC 100076000660** Installation of approximately 200 feet of 3-inch 60# plastic gas service near 25<sup>th</sup> Street and Highway 370. The service extension will provide natural gas to the Bellevue Medical Center. The proposed gas service extension will be located entirely within Bellevue's city limits. The anticipated installation date is December 10, 2008.


A map depicting the proposed extension is attached hereto.

  
Daniel G. Crouchley  
Senior Vice President, General Counsel


DGC/sms

Enclosures

cc: Patrick J. Joyce  
Senior Counsel  
Black Hills Corp.  
1815 Capitol Avenue  
Omaha, Nebraska 68102

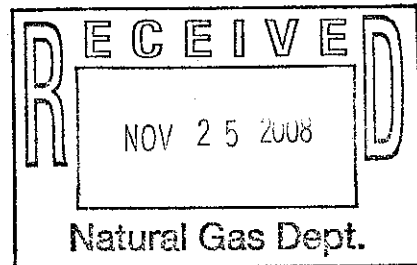

Hwy 370

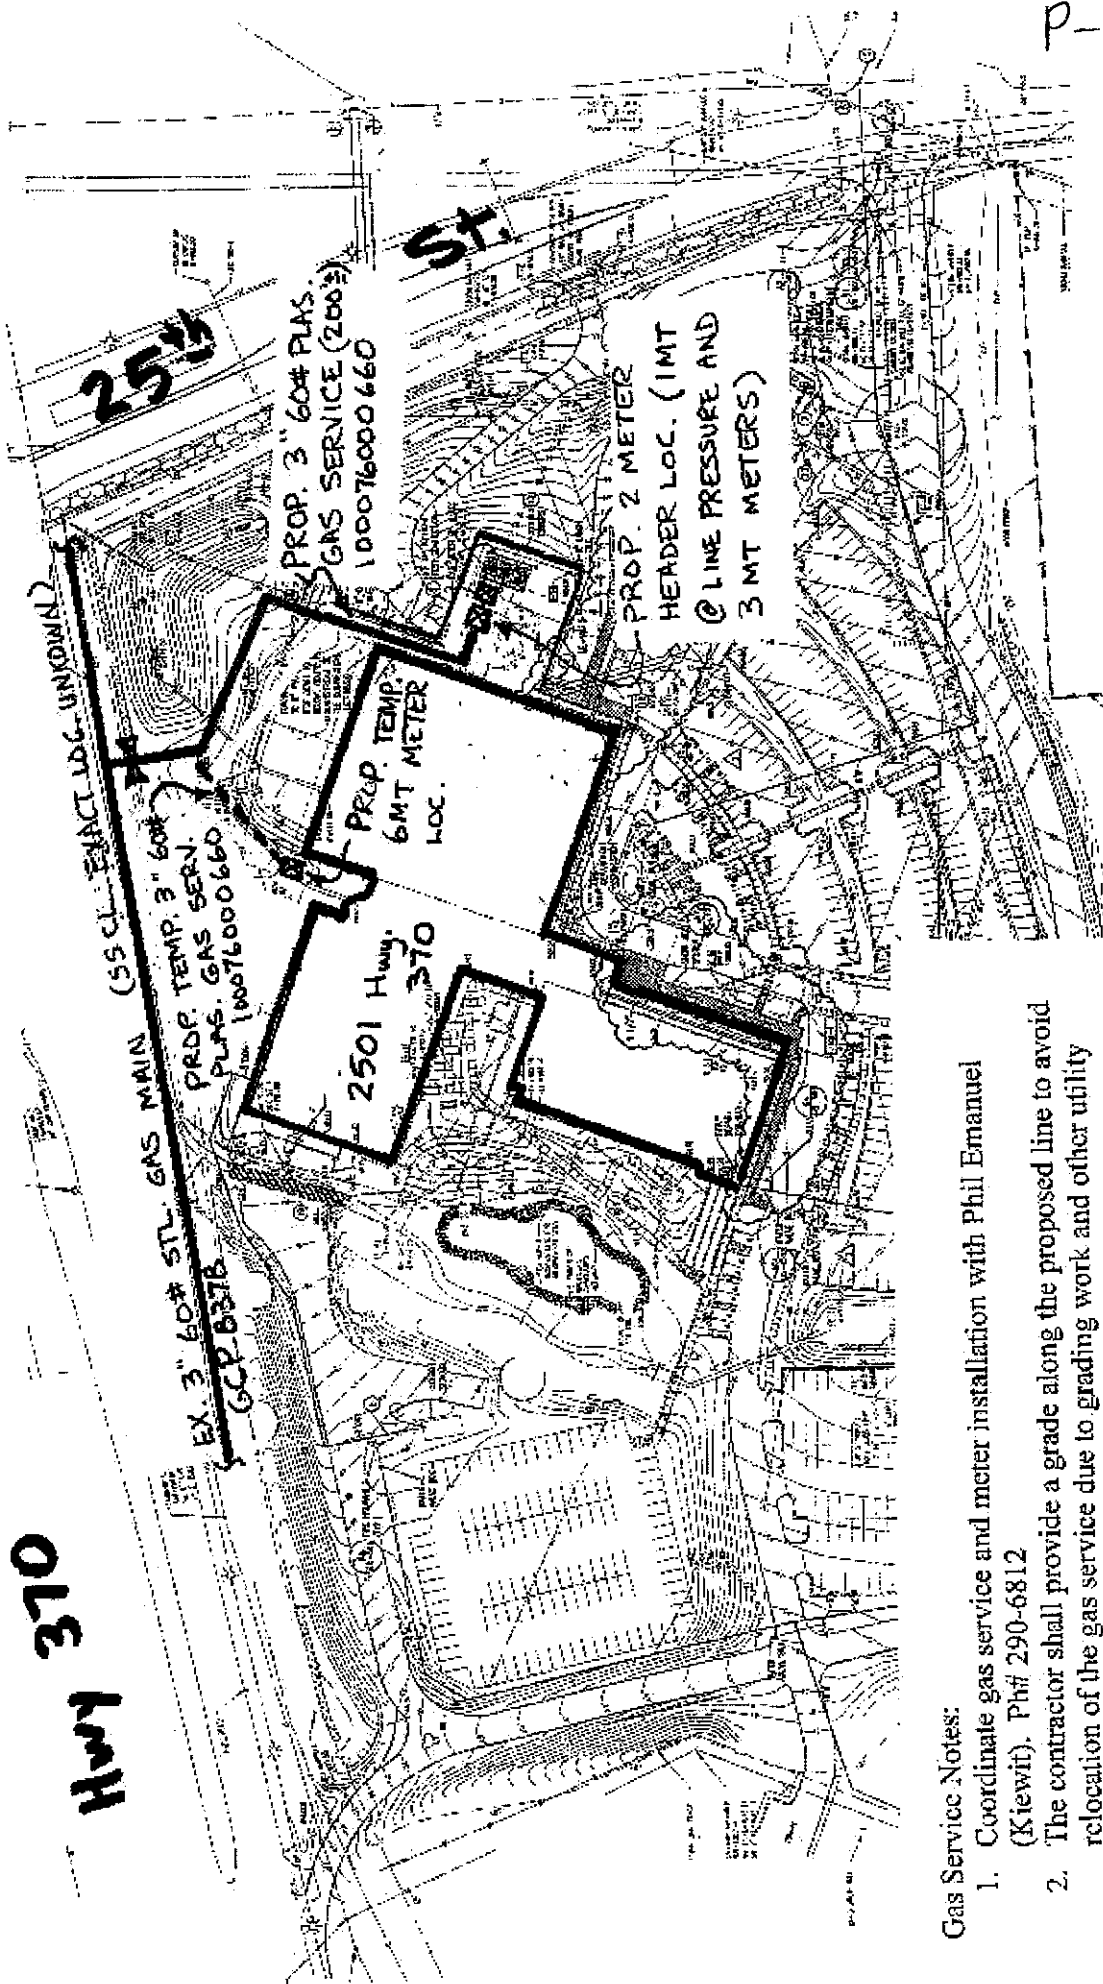

**R E C E I V E D**  
 NOV 25 2008  
 Natural Gas Dept.

Gas Service Notes:

1. Coordinate gas service and meter installation with Phil Emanuel (Kiewit), Ph# 290-6812
2. The contractor shall provide a grade along the proposed line to avoid relocation of the gas service due to grading work and other utility installations.
3. A temporary meter location is required for construction heat prior to the installation of the gas service to the permanent 2 meter header. Coordinate the installation and abandonment of the temporary line and the installation of the permanent service with the contractor.
4. The contractor shall pour a pad specified by the District's Construction Foreman for the temporary meter set.
5. The contractor shall provide protection to the temporary meter set by the installation of bollards or jersey barriers.